


This page contains personally identifiable information that is not publicly releasable under Exemption 6 of the federal Freedom of Information Act, 5 U.S.C. section 552.

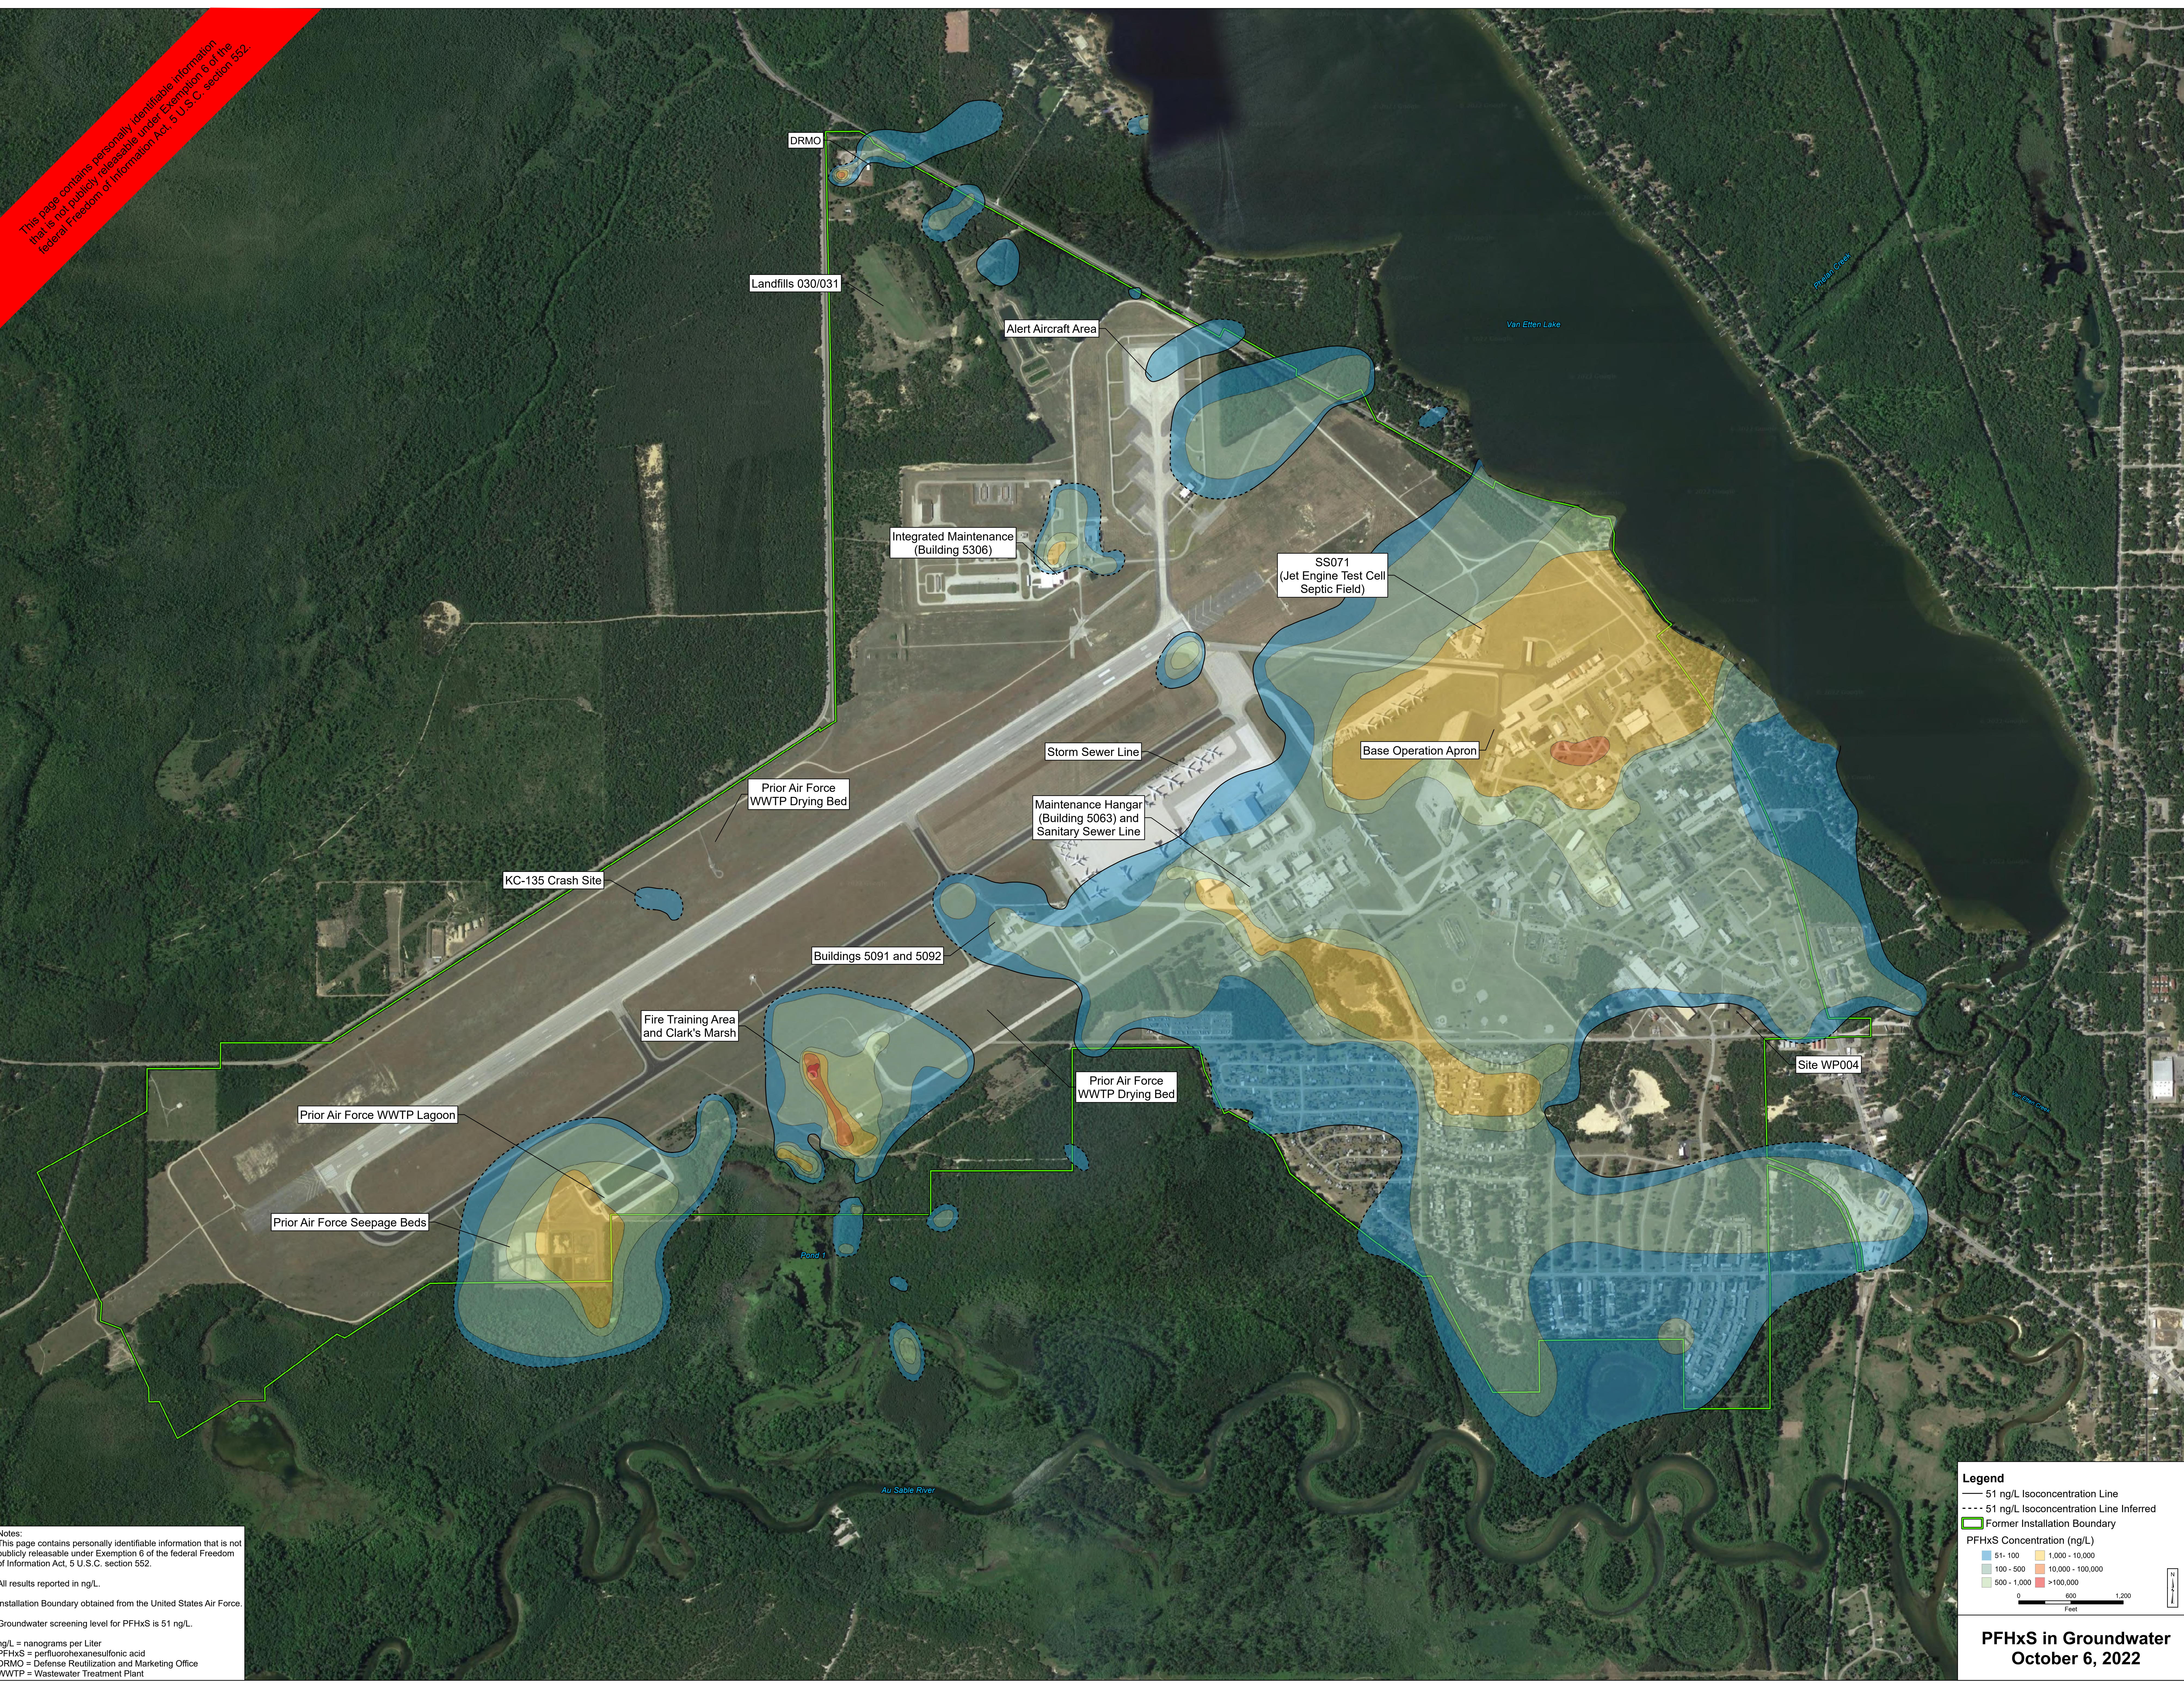

Notes:
 This page contains personally identifiable information that is not publicly releasable under Exemption 6 of the federal Freedom of Information Act, 5 U.S.C. section 552.
 All results reported in ng/L.
 Installation Boundary obtained from the United States Air Force.
 Groundwater screening level for PFHxS is 51 ng/L.
 ng/L = nanograms per Liter
 PFHxS = perfluorohexanesulfonic acid
 DRMO = Defense Reutilization and Marketing Office
 WWTP = Wastewater Treatment Plant

Legend

- 51 ng/L Isoconcentration Line
- - - 51 ng/L Isoconcentration Line Inferred
- ▭ Former Installation Boundary

PFHxS Concentration (ng/L)

51 - 100	1,000 - 10,000
100 - 500	10,000 - 100,000
500 - 1,000	>100,000

0 600 1,200 Feet

**PFHxS in Groundwater
 October 6, 2022**