


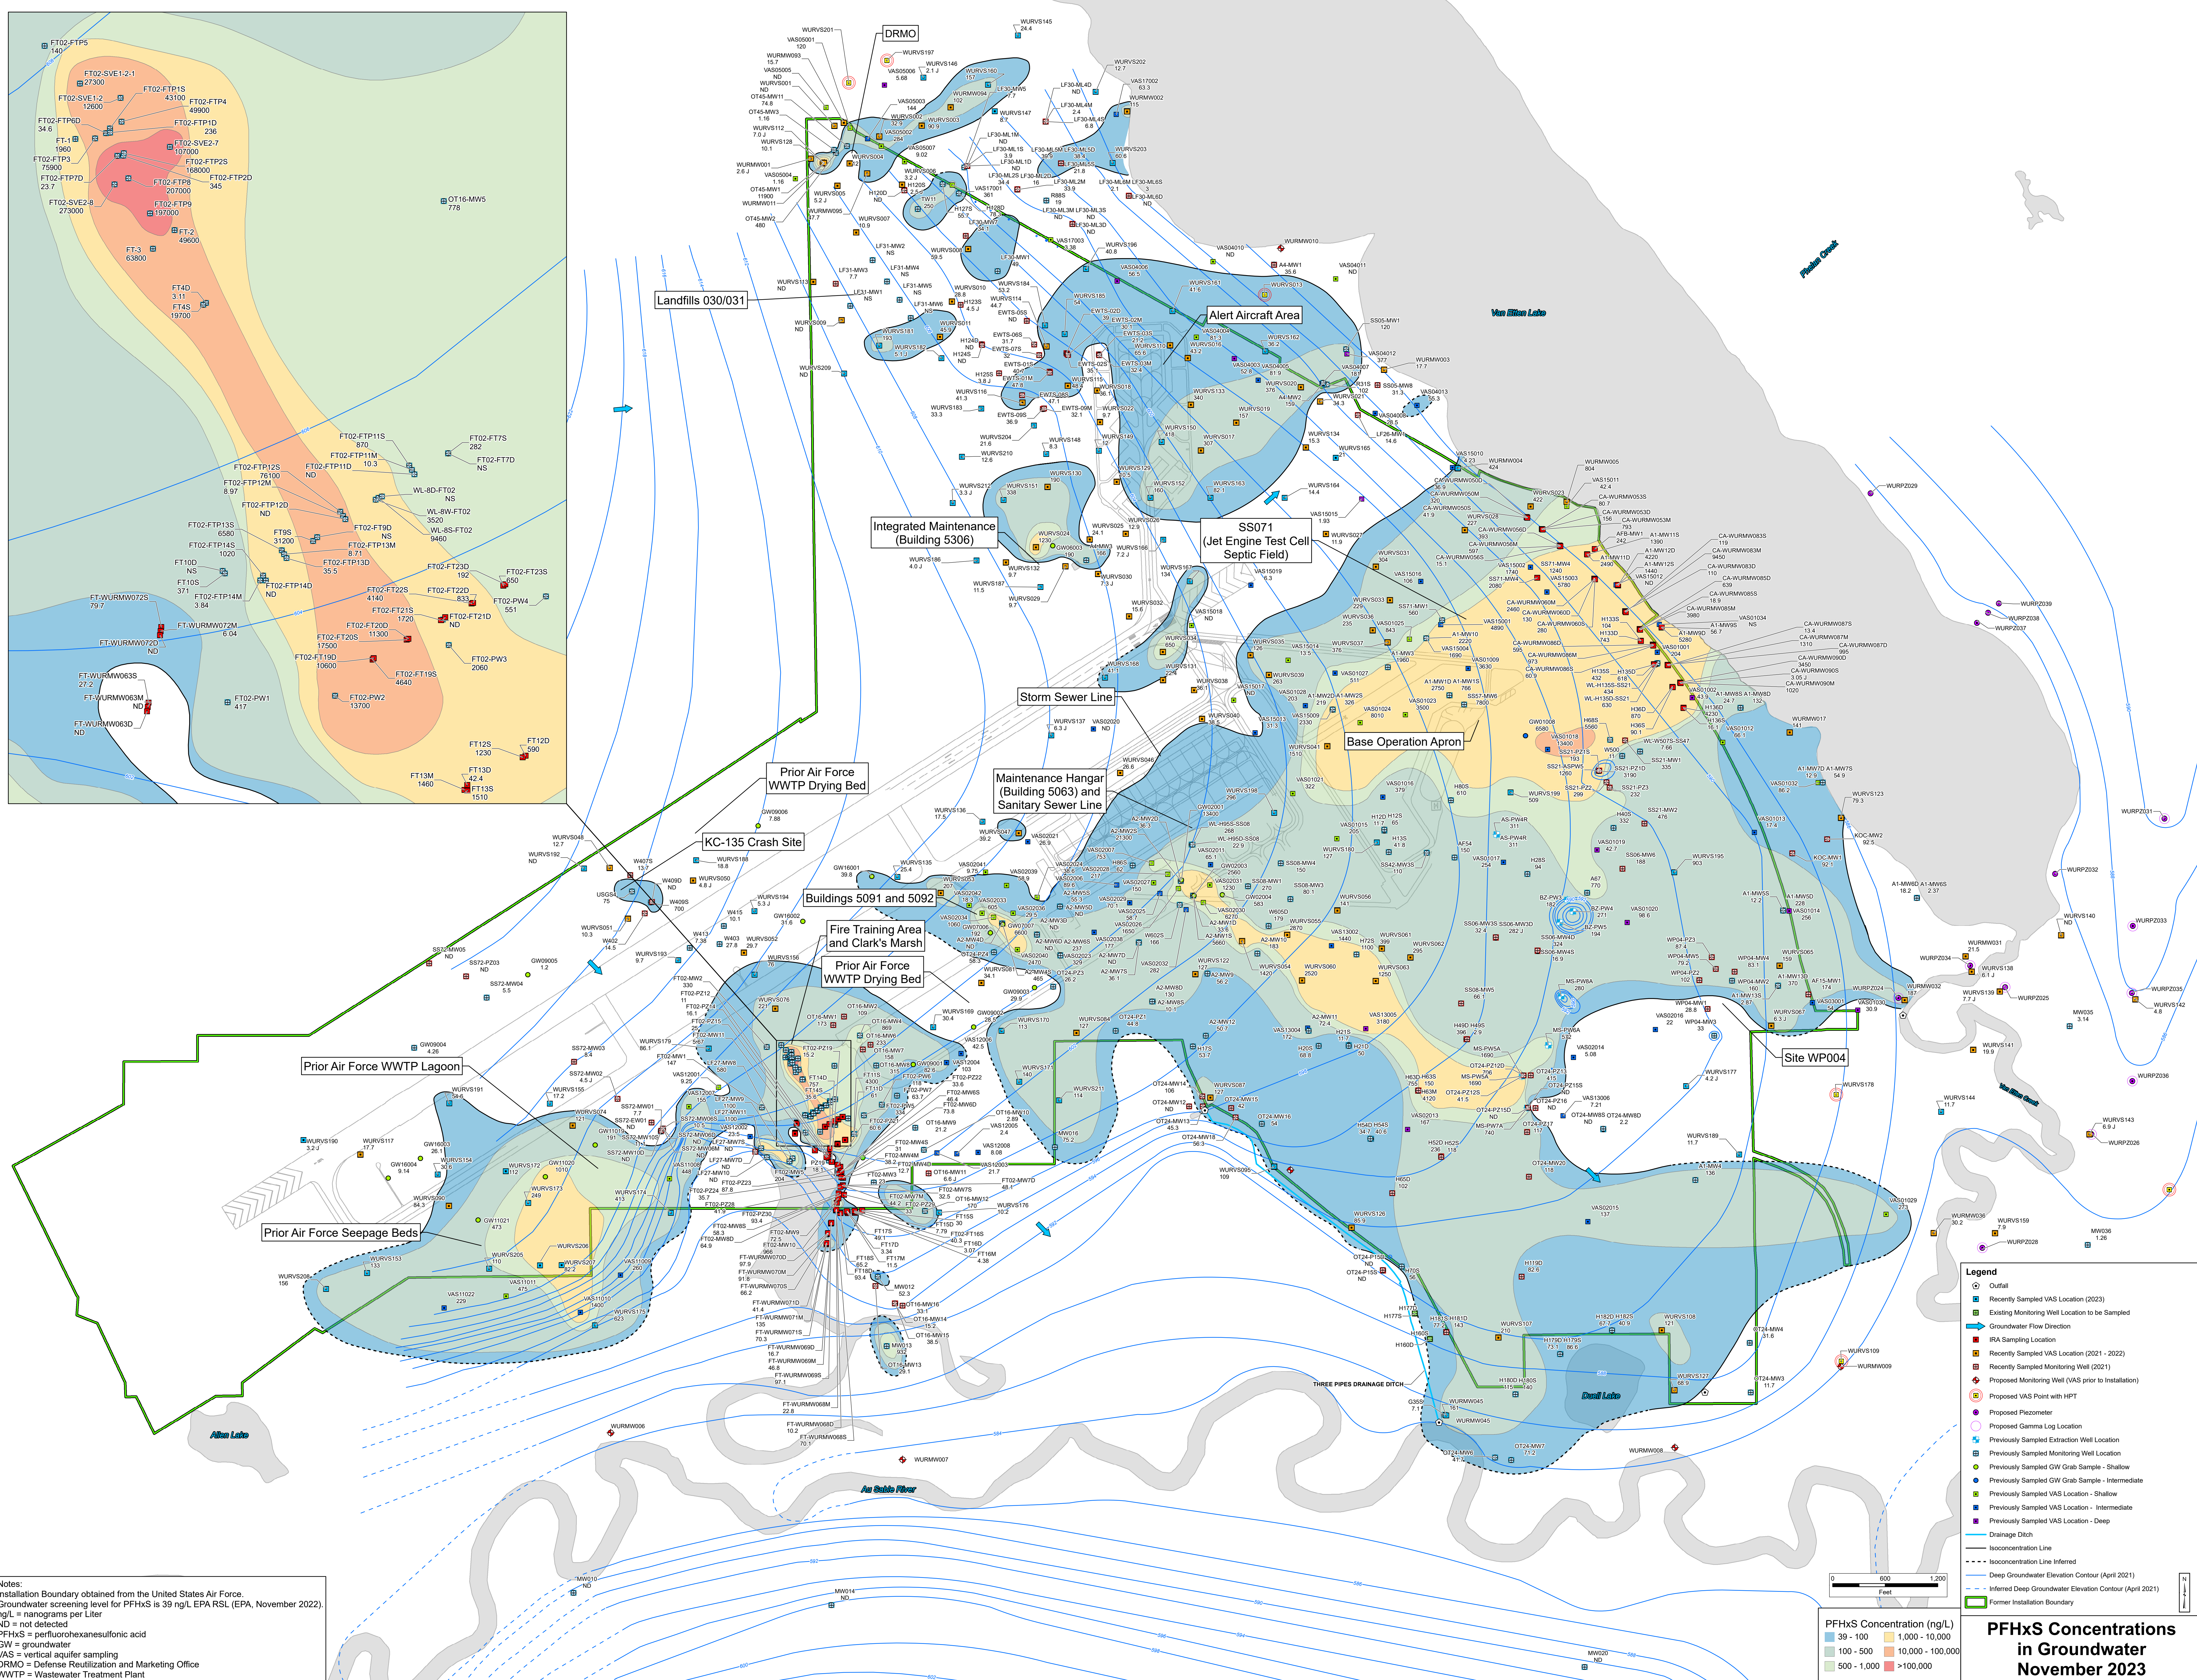

Notes:
Installation Boundary obtained from the United States Air Force.
Groundwater screening level for PFHxS is 39 ng/L EPA RSL (EPA, November 2022).
ng/L = nanograms per Liter
ND = not detected
PFHxS = perfluorohexanesulfonic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant

Legend

- Outfall
- Recently Sampled VAS Location (2023)
- Existing Monitoring Well Location to be Sampled
- Groundwater Flow Direction
- IRA Sampling Location
- Recently Sampled VAS Location (2021 - 2022)
- Recently Sampled Monitoring Well (2021)
- Proposed Monitoring Well (VAS prior to installation)
- Proposed VAS Point with HPT
- Proposed Piezometer
- Proposed Gamma Log Location
- Previously Sampled Extraction Well Location
- Previously Sampled Monitoring Well Location
- Previously Sampled GW Grab Sample - Shallow
- Previously Sampled GW Grab Sample - Intermediate
- Previously Sampled VAS Location - Shallow
- Previously Sampled VAS Location - Intermediate
- Previously Sampled VAS Location - Deep
- Drainage Ditch
- Isocentration Line
- Isocentration Line Inferred
- Deep Groundwater Elevation Contour (April 2021)
- Inferred Deep Groundwater Elevation Contour (April 2021)
- Former Installation Boundary

PFHxS Concentration (ng/L)

- 39 - 100
- 100 - 500
- 500 - 1,000
- 1,000 - 10,000
- 10,000 - 100,000
- >100,000

PFHxS Concentrations in Groundwater November 2023