


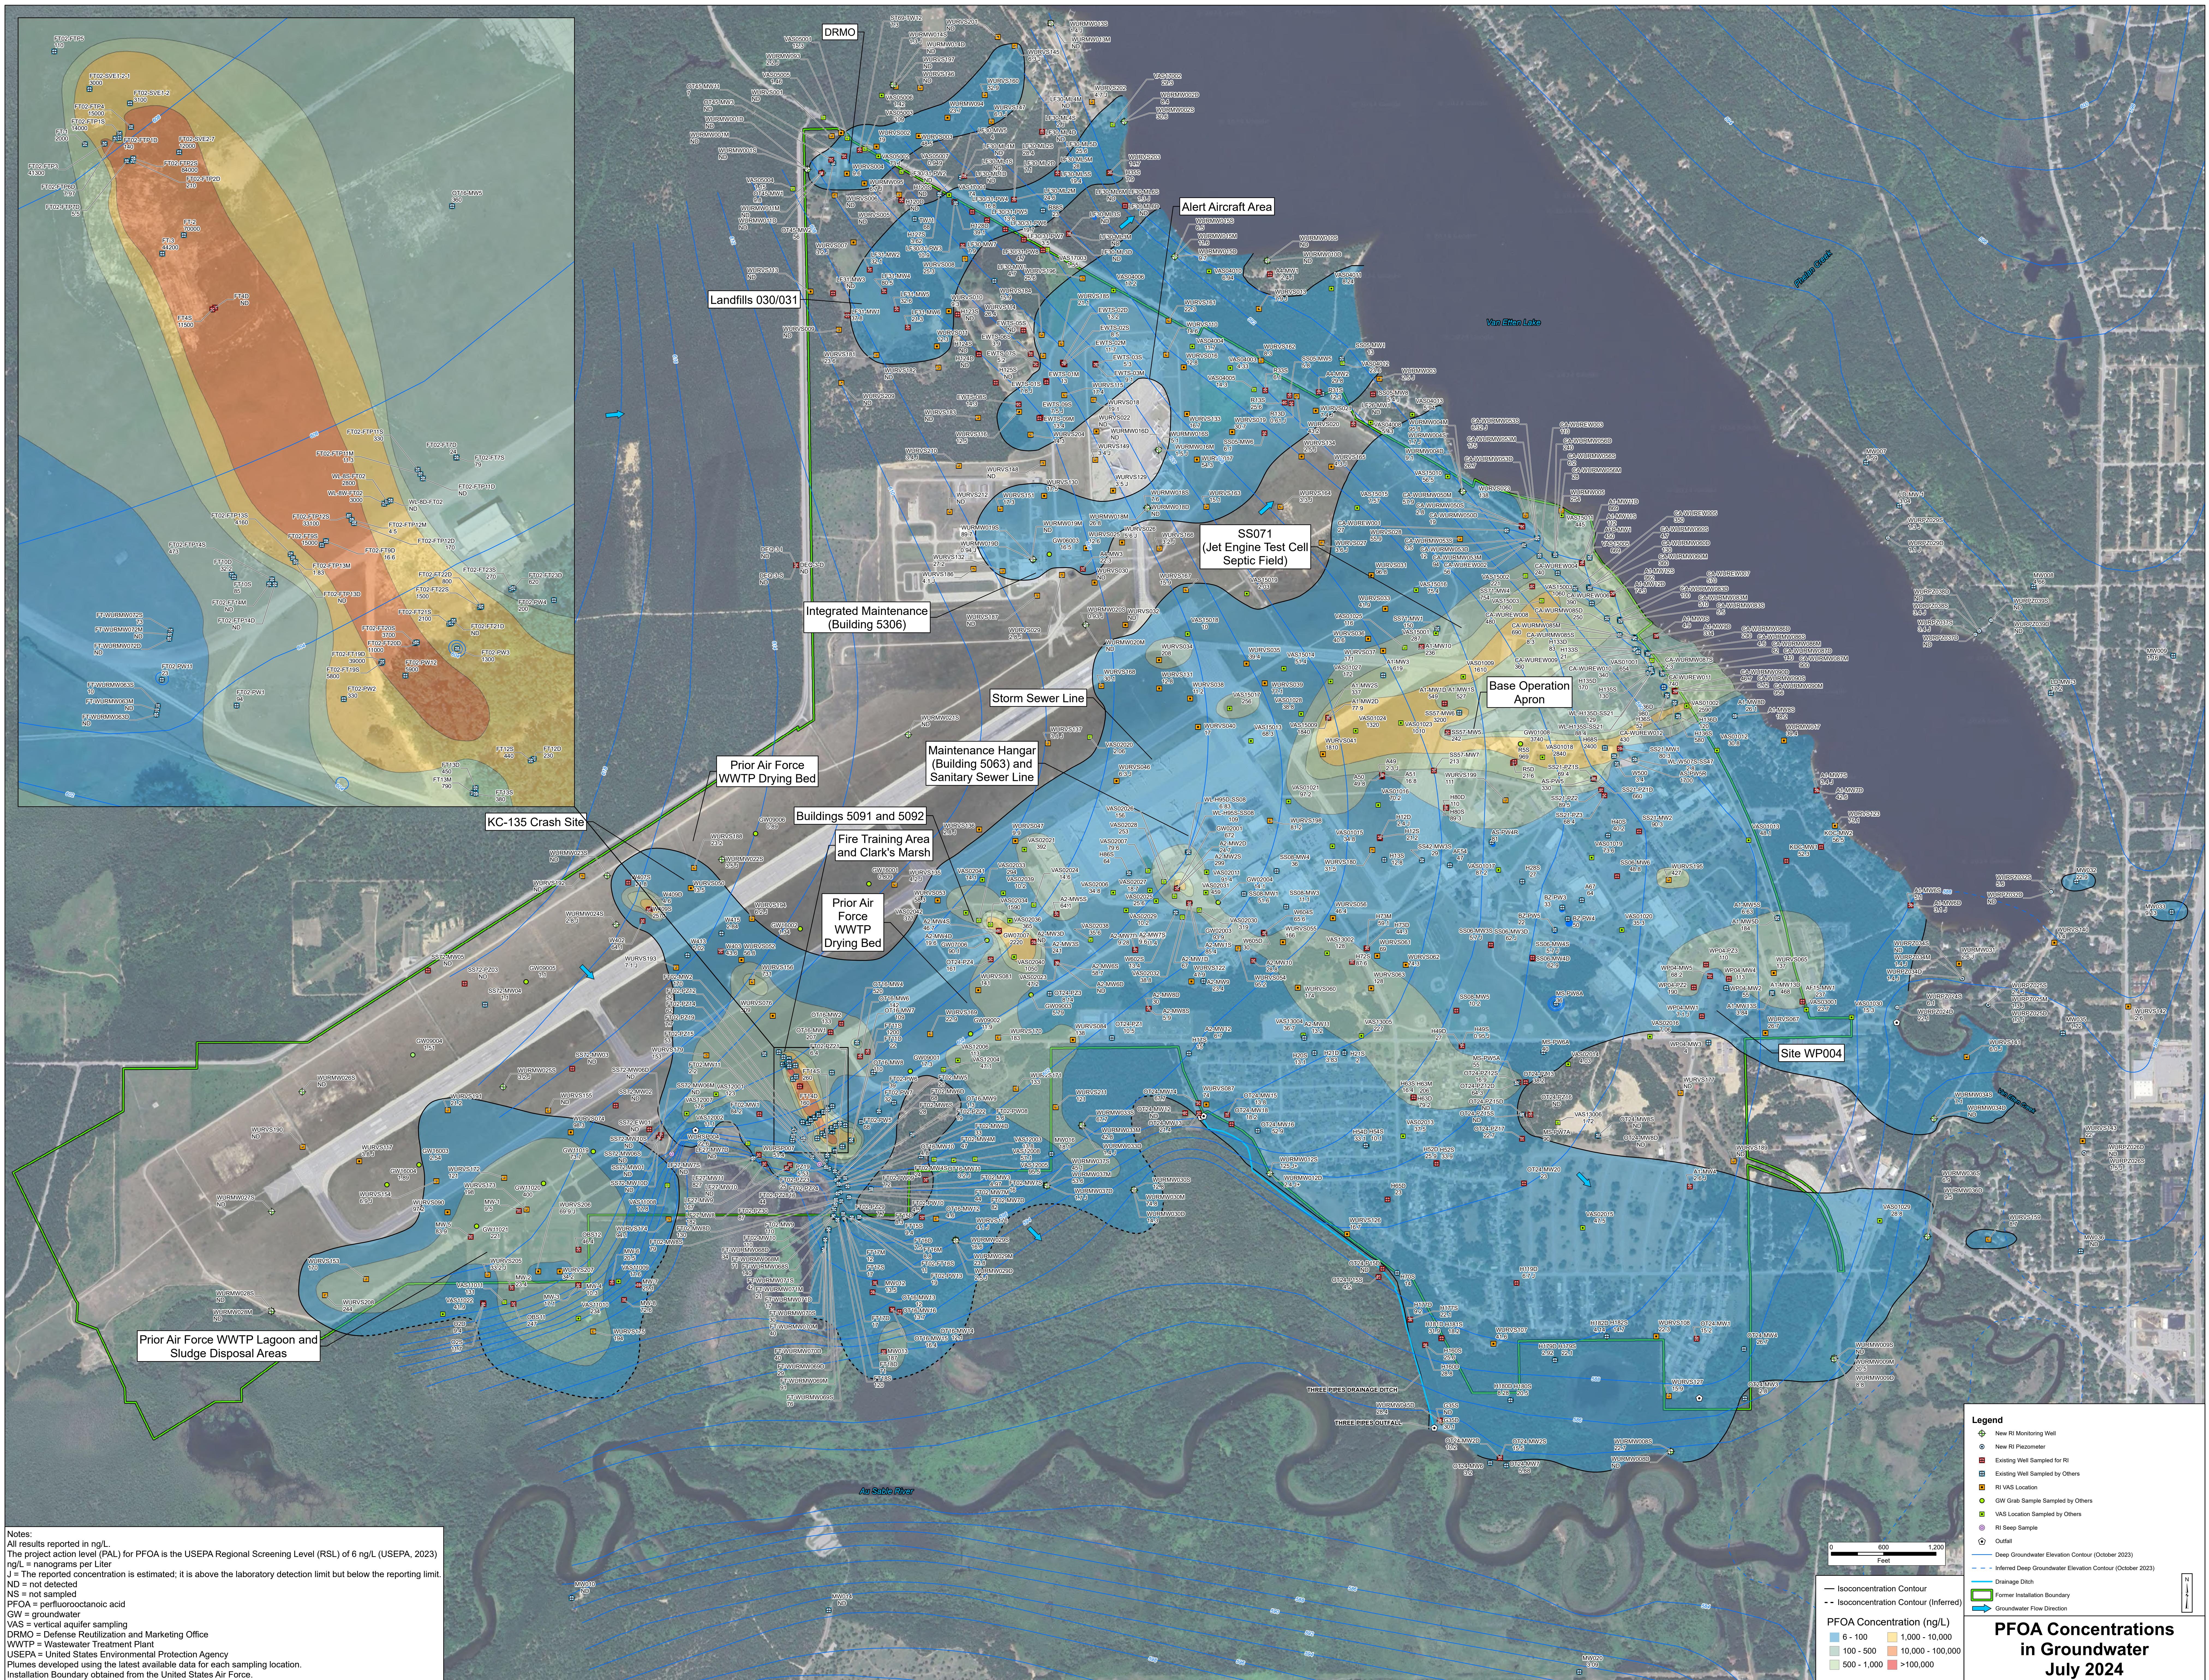

Notes:
All results reported in ng/L.
The project action level (PAL) for PFOA is the USEPA Regional Screening Level (RSL) of 6 ng/L (USEPA, 2023)
ng/L = nanograms per liter
J = The reported concentration is estimated; it is above the laboratory detection limit but below the reporting limit.
ND = not detected
NS = not sampled
PFOA = perfluorooctanoic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant
USEPA = United States Environmental Protection Agency
Plumes developed using the latest available data for each sampling location.
Installation Boundary obtained from the United States Air Force.

Legend

- New RI Monitoring Well
- New RI Piezometer
- Existing Well Sampled for RI
- Existing Well Sampled by Others
- RI VAS Location
- GW Grab Sample Sampled by Others
- VAS Location Sampled by Others
- RI Seep Sample
- Outfall
- Deep Groundwater Elevation Contour (October 2023)
- Inferred Deep Groundwater Elevation Contour (October 2023)
- Drainage Ditch
- Former Installation Boundary
- Groundwater Flow Direction

PFOA Concentration (ng/L)

6 - 100	1,000 - 10,000
100 - 500	10,000 - 100,000
500 - 1,000	>100,000

PFOA Concentrations in Groundwater July 2024