



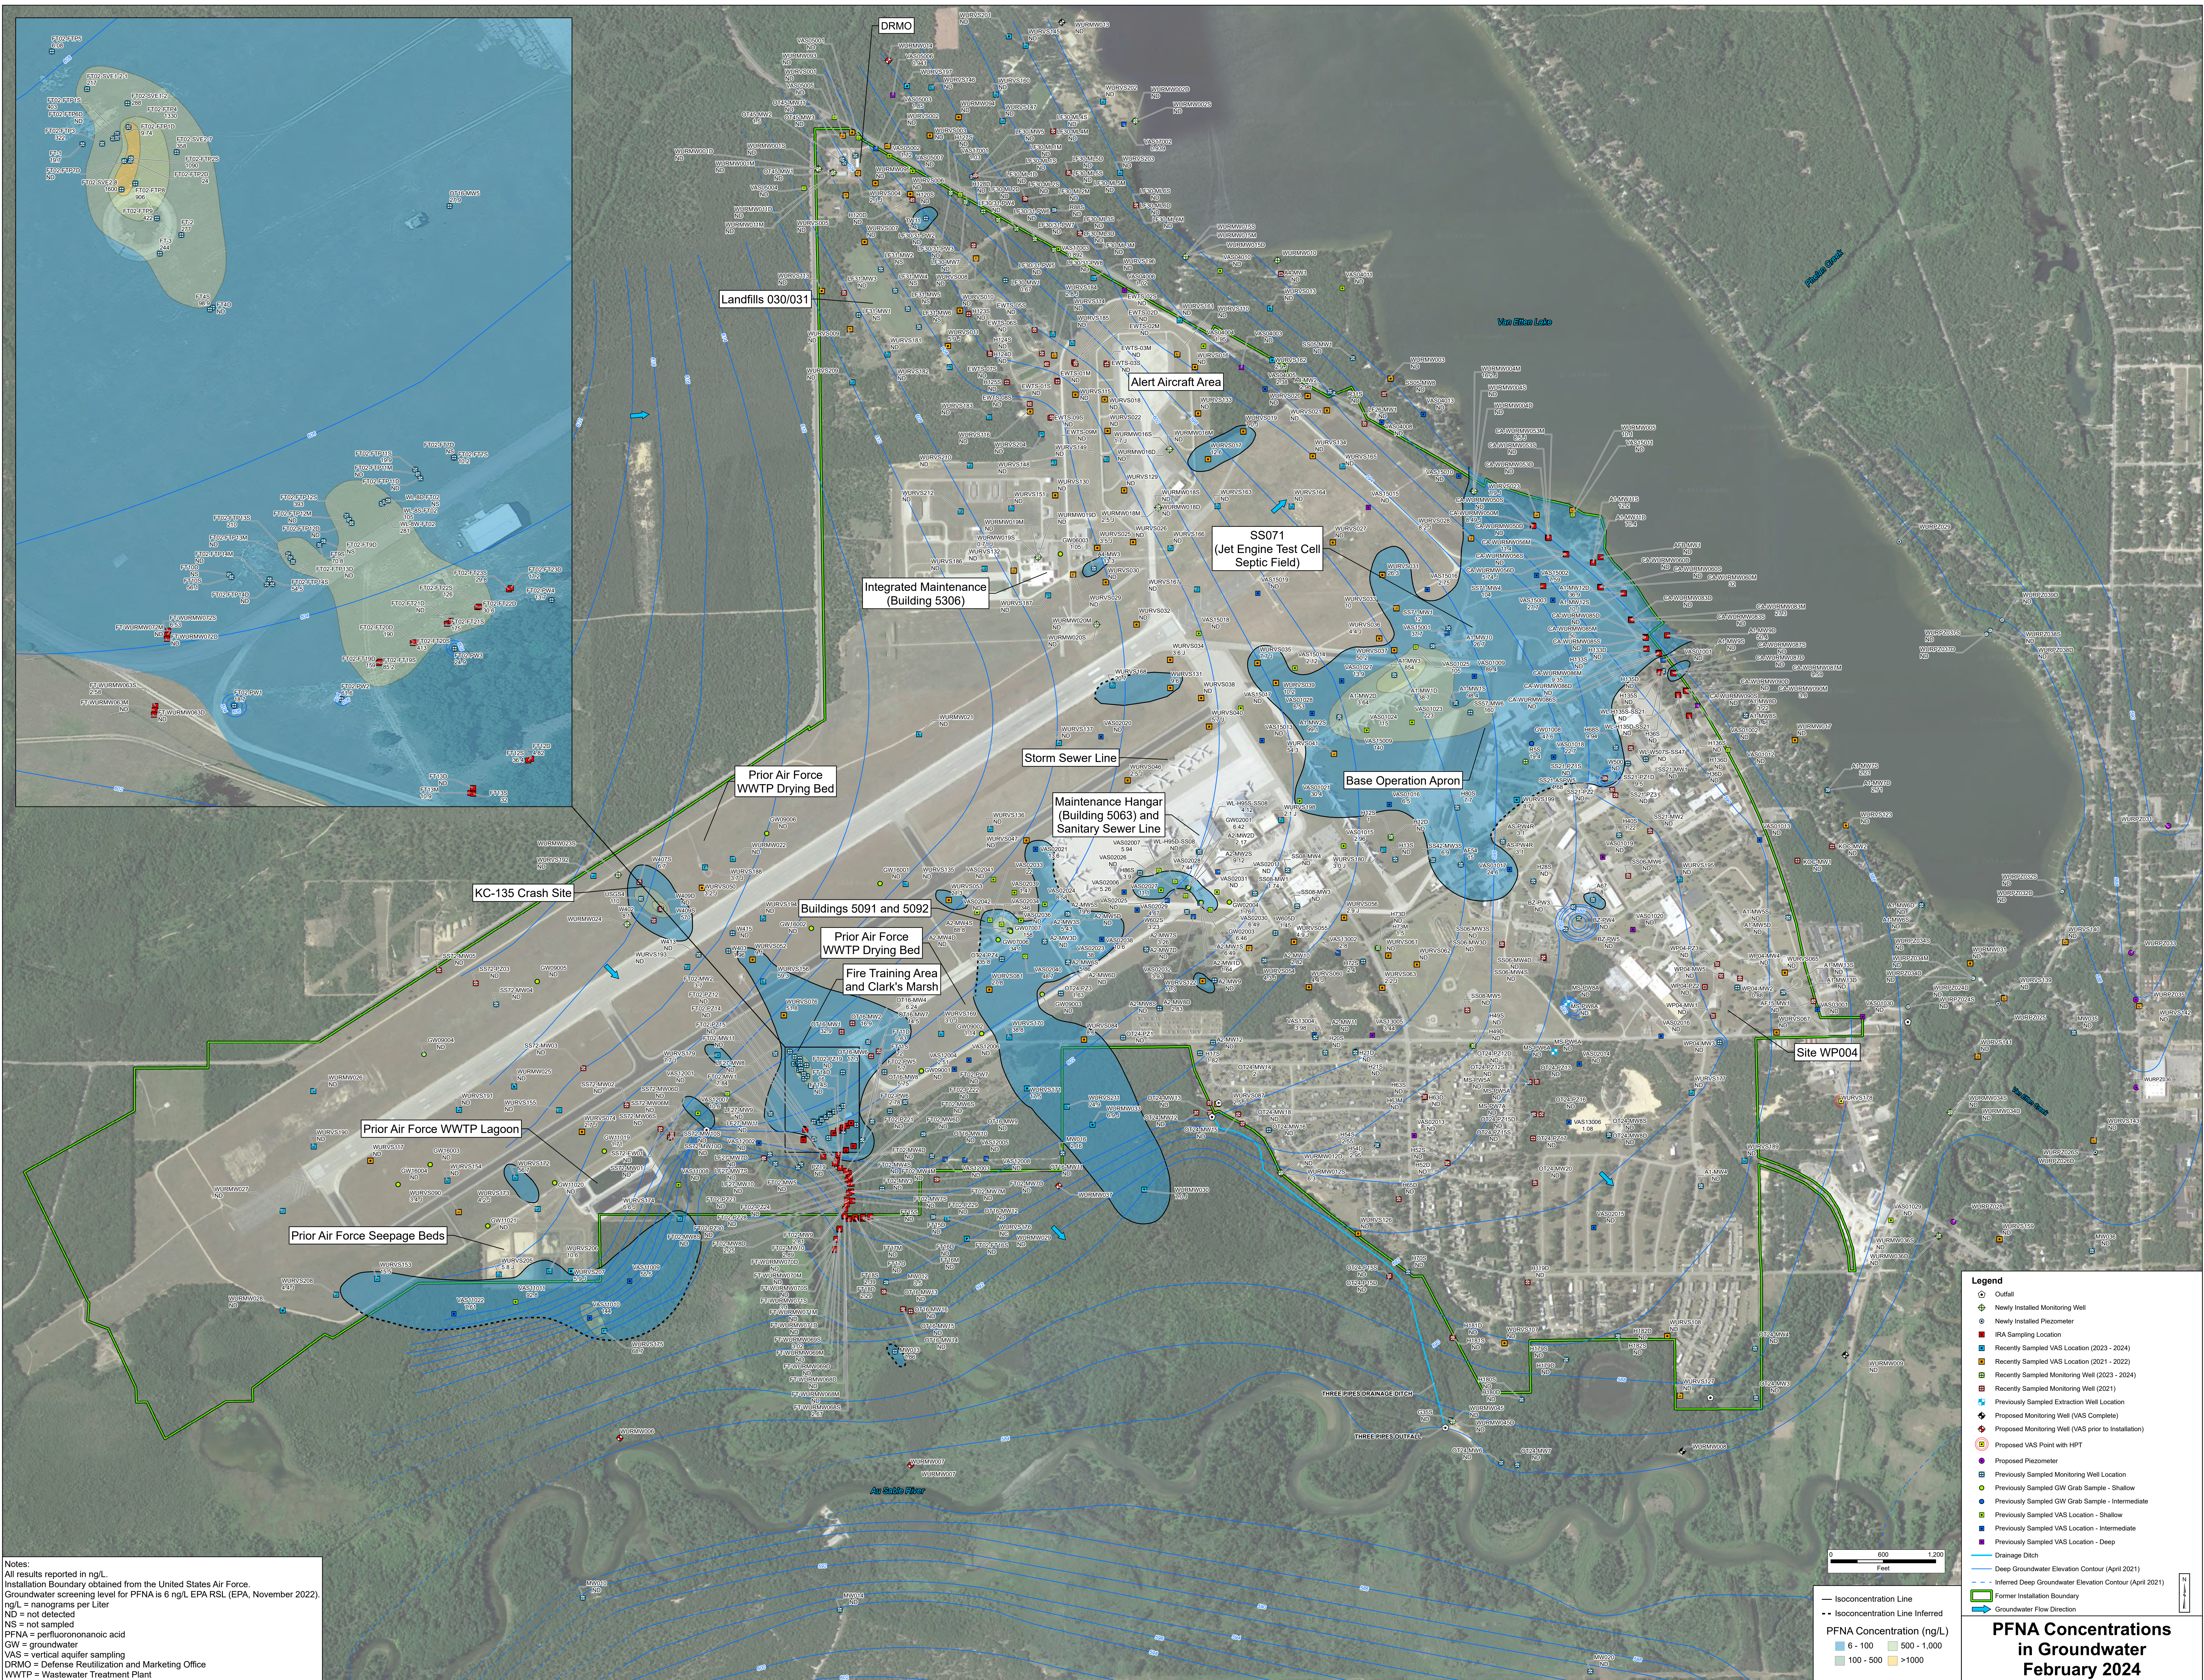

Notes:
All results reported in ng/L.
Installation Boundary obtained from the United States Air Force.
Groundwater screening level for PFNA is 6 ng/L EPA RSL (EPA, November 2022).
ng/L = nanograms per Liter
ND = not detected
NS = not sampled
PFNA = perfluorononanoic acid
GW = groundwater
VAS = vertical aquifer sampling
DRMO = Defense Reutilization and Marketing Office
WWTP = Wastewater Treatment Plant

- Legend**
- Outfall
 - Newly Installed Monitoring Well
 - Newly Installed Piezometer
 - IRA Sampling Location
 - Recently Sampled VAS Location (2023 - 2024)
 - Recently Sampled VAS Location (2021 - 2022)
 - Recently Sampled Monitoring Well (2023 - 2024)
 - Recently Sampled Monitoring Well (2021)
 - Previously Sampled Extraction Well Location
 - Proposed Monitoring Well (VAS Complete)
 - Proposed Monitoring Well (VAS prior to installation)
 - Proposed VAS Point with HPT
 - Proposed Piezometer
 - Previously Sampled Monitoring Well Location
 - Previously Sampled GW Grab Sample - Shallow
 - Previously Sampled GW Grab Sample - Intermediate
 - Previously Sampled VAS Location - Shallow
 - Previously Sampled VAS Location - Intermediate
 - Previously Sampled VAS Location - Deep
 - Drainage Ditch
 - Deep Groundwater Elevation Contour (April 2021)
 - Inferred Deep Groundwater Elevation Contour (April 2021)
 - Former Installation Boundary
 - Groundwater Flow Direction

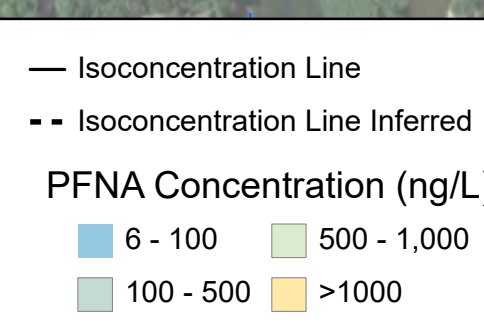

**PFNA Concentrations
in Groundwater
February 2024**