


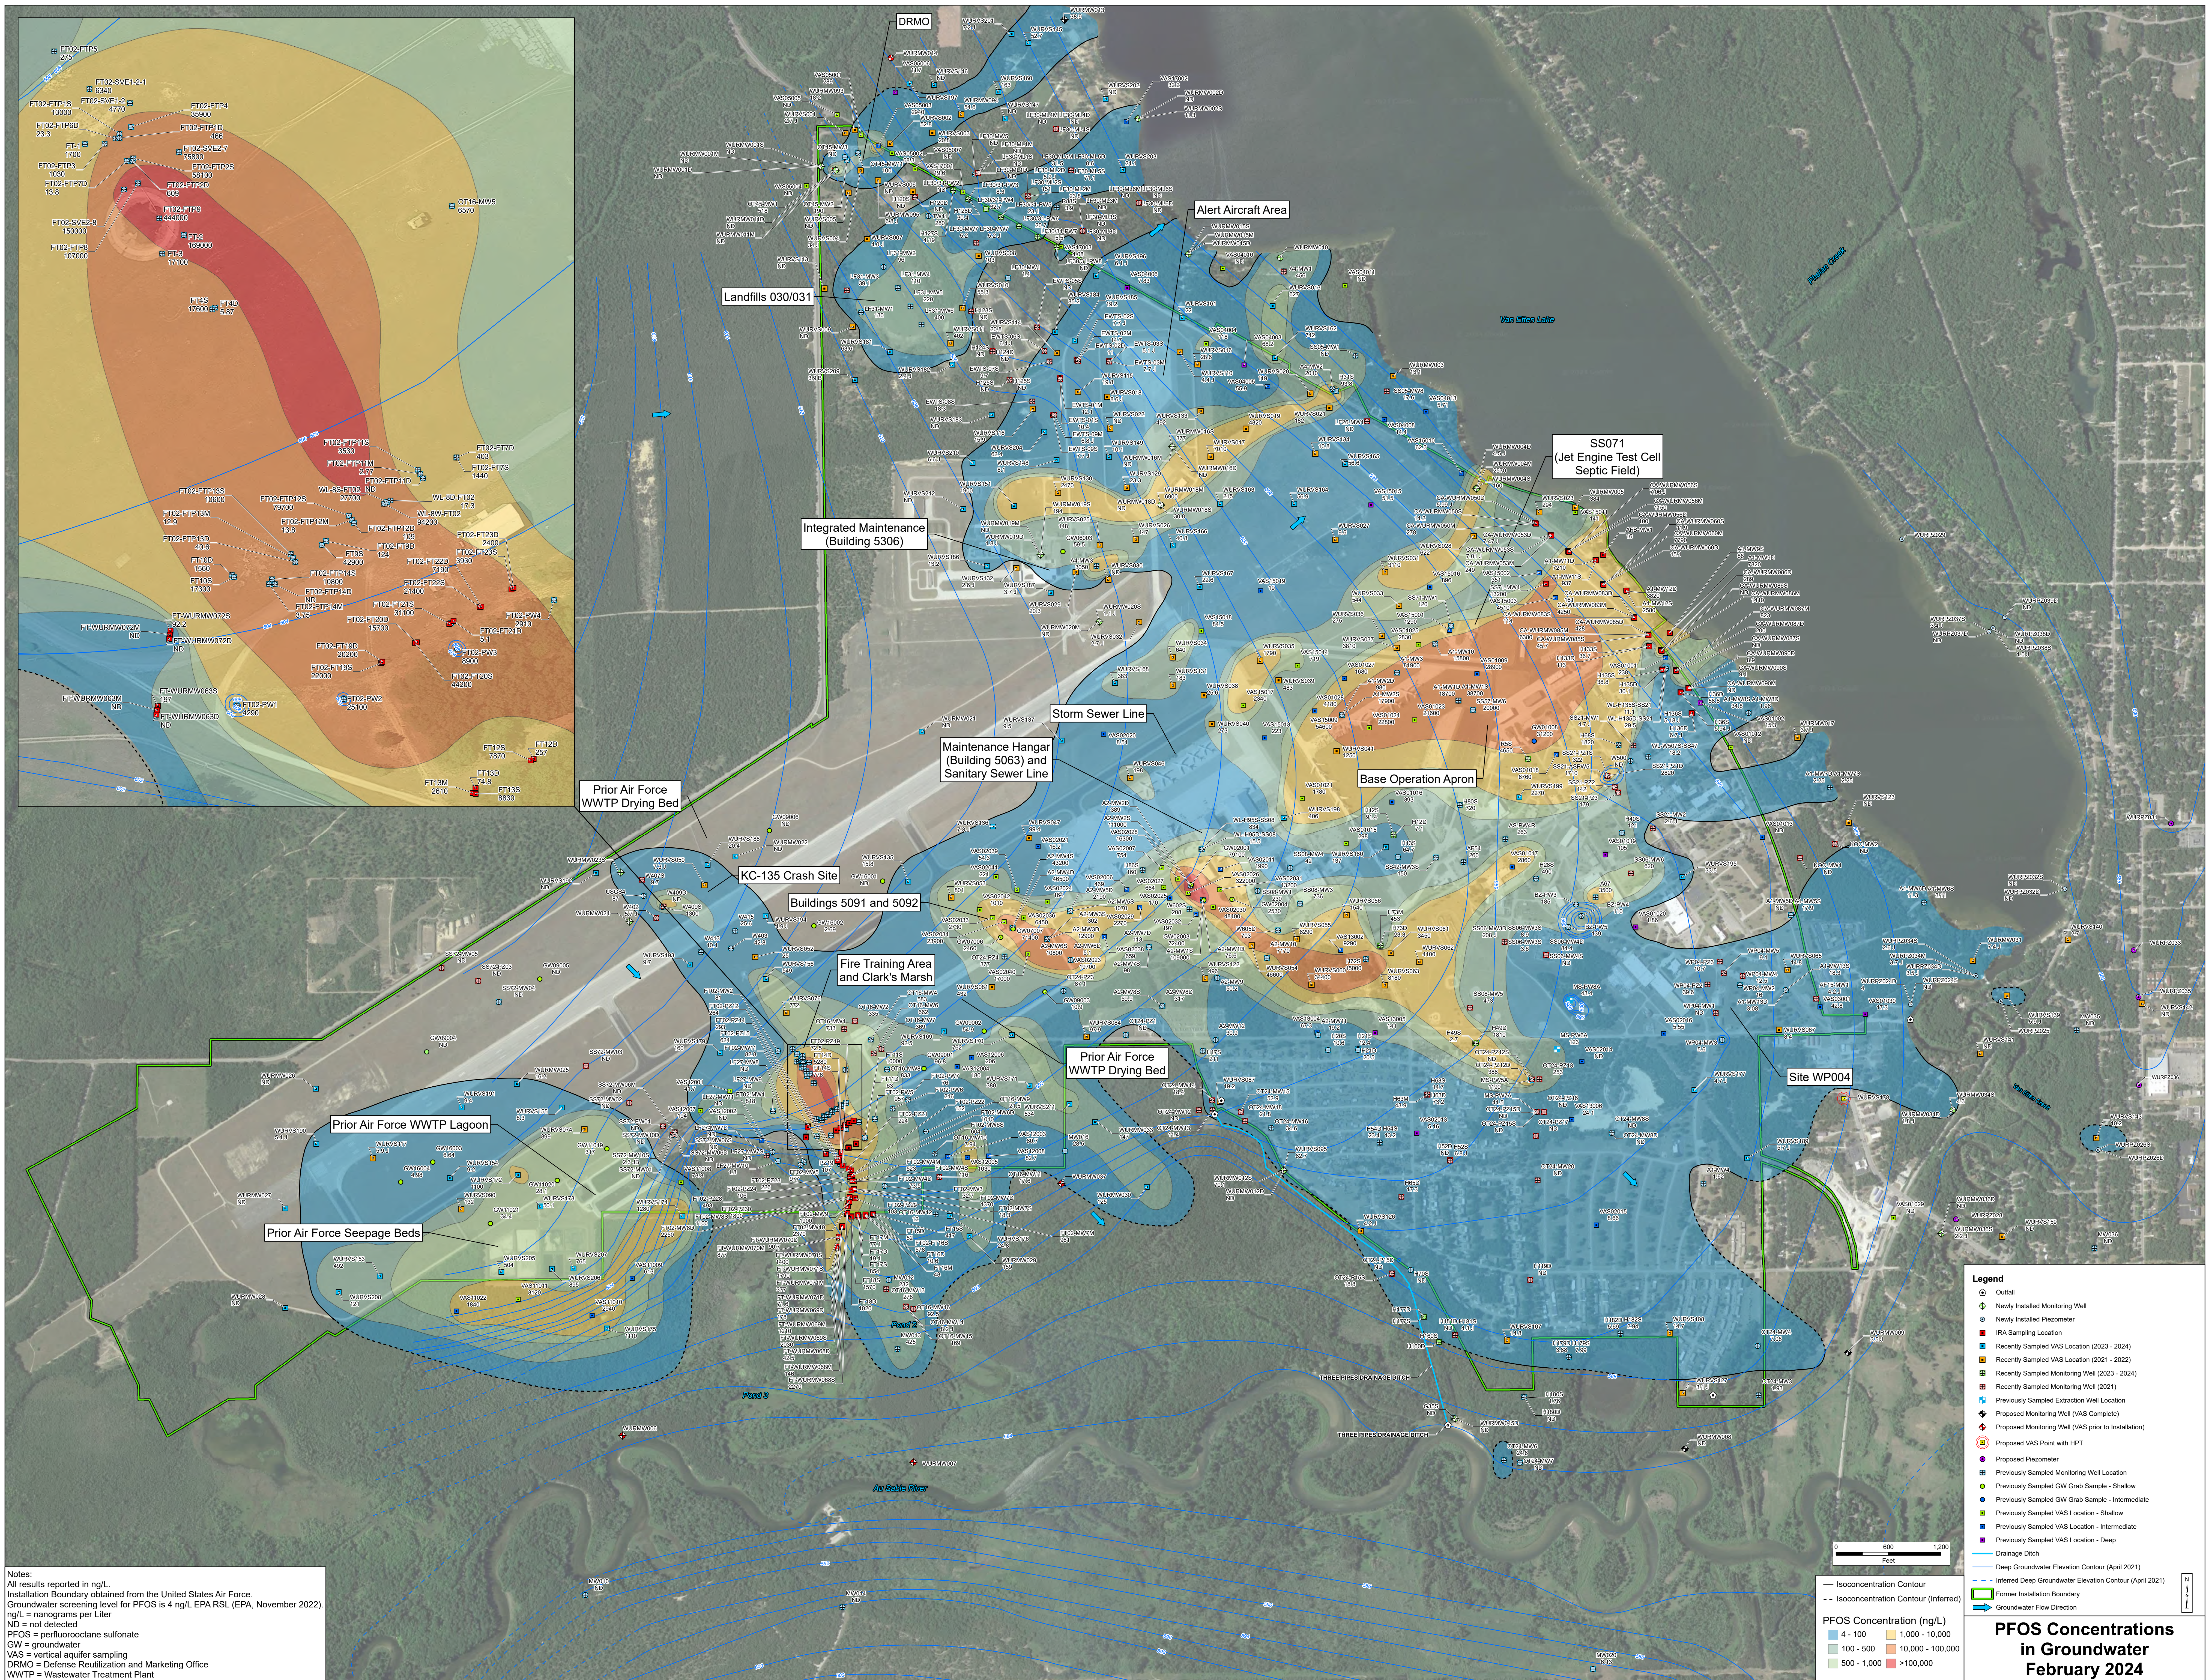

Notes:  
All results reported in ng/L.  
Installation Boundary obtained from the United States Air Force.  
Groundwater screening level for PFOS is 4 ng/L EPA RSL (EPA, November 2022).  
ng/L = nanograms per Liter  
ND = not detected  
PFOS = perfluorooctane sulfonate  
GW = groundwater  
VAS = vertical aquifer sampling  
DRMO = Defense Reutilization and Marketing Office  
WWTP = Wastewater Treatment Plant

**Legend**

- Outfall
- Newly Installed Monitoring Well
- Newly Installed Piezometer
- IRA Sampling Location
- Recently Sampled VAS Location (2023 - 2024)
- Recently Sampled Monitoring Well (2021 - 2022)
- Recently Sampled VAS Location (2021)
- Previously Sampled Extraction Well Location
- Proposed Monitoring Well (VAS Complete)
- Proposed Monitoring Well (VAS prior to installation)
- Proposed VAS Point with HPT
- Proposed Piezometer
- Previously Sampled Monitoring Well Location
- Previously Sampled GW Grab Sample - Shallow
- Previously Sampled GW Grab Sample - Intermediate
- Previously Sampled VAS Location - Shallow
- Previously Sampled VAS Location - Intermediate
- Previously Sampled VAS Location - Deep
- Drainage Ditch
- Deep Groundwater Elevation Contour (April 2021)
- Inferred Deep Groundwater Elevation Contour (April 2021)
- Inferred Installation Boundary
- Groundwater Flow Direction

**PFOS Concentration (ng/L)**

- 4 - 100
- 100 - 500
- 500 - 1,000
- 1,000 - 10,000
- 10,000 - 100,000
- >100,000

**PFOS Concentrations in Groundwater February 2024**