


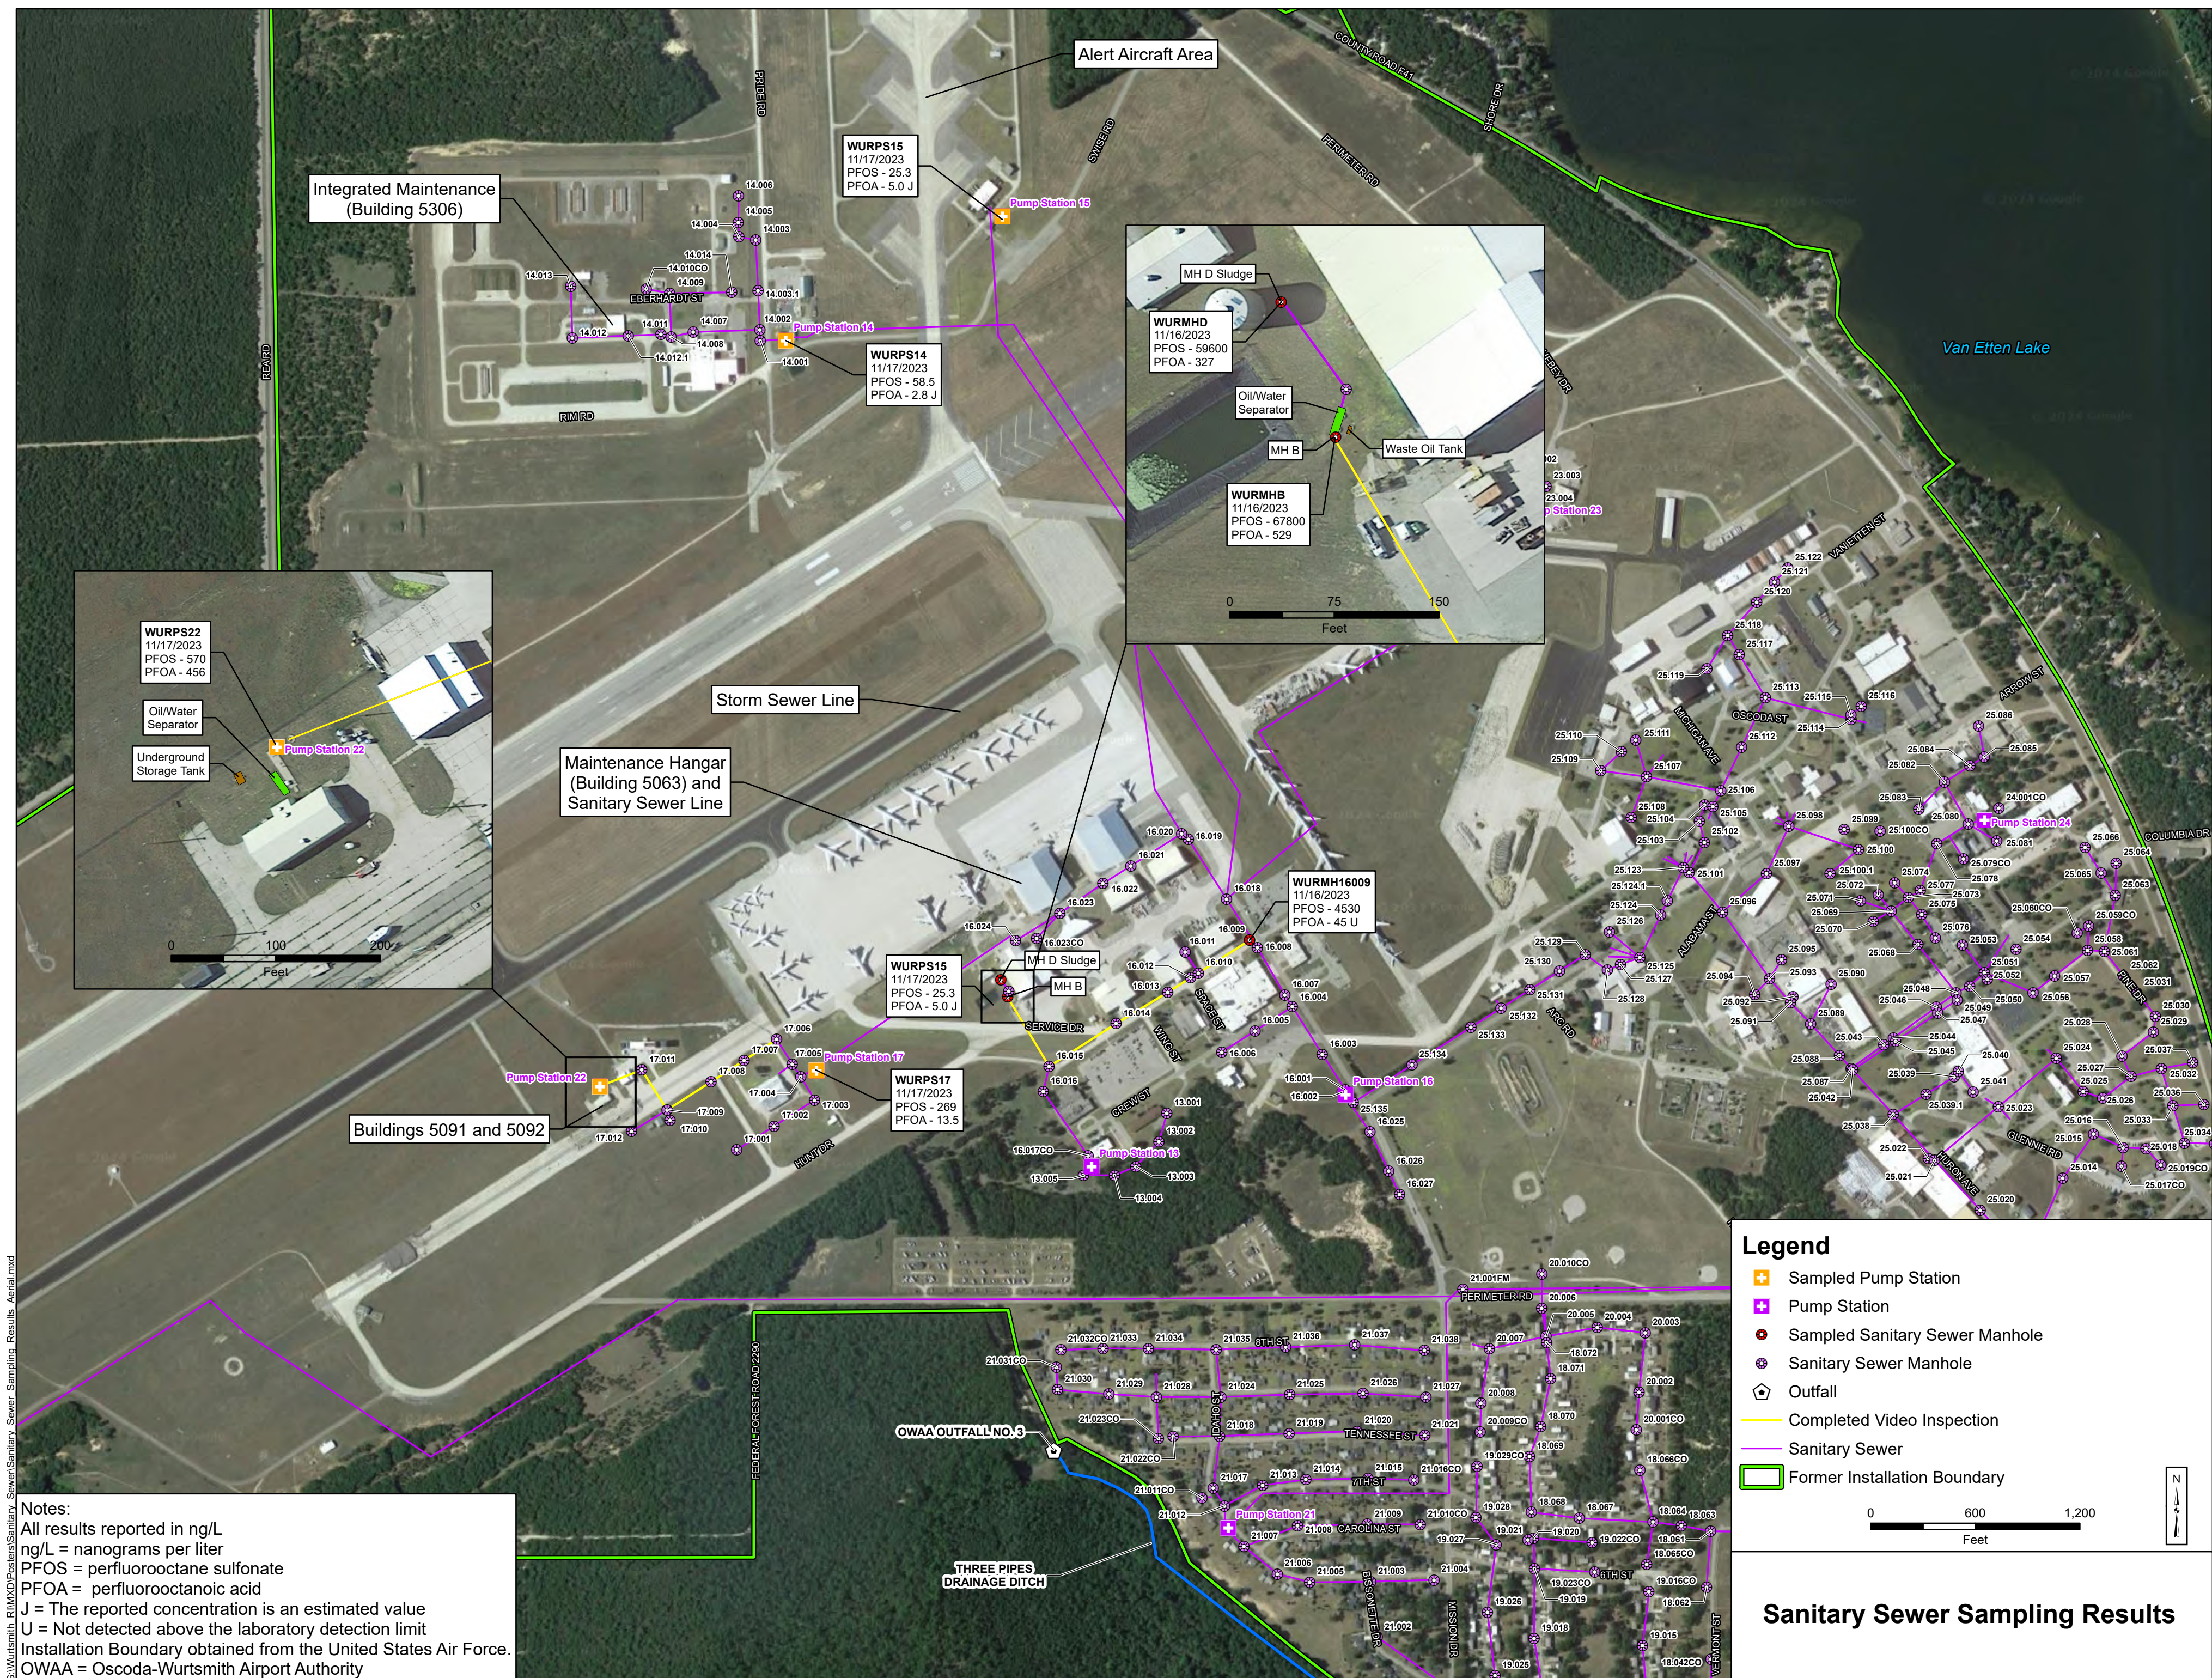

G:\Wurtsmith_RUMXD\Outputs\Sanitary Sewer Sampling Results Aerial.mxd

Notes:
All results reported in ng/L
ng/L = nanograms per liter
PFOS = perfluorooctane sulfonate
PFOA = perfluorooctanoic acid
J = The reported concentration is an estimated value
U = Not detected above the laboratory detection limit
Installation Boundary obtained from the United States Air Force.
OWAA = Oscoda-Wurtsmith Airport Authority

Legend

- Sampled Pump Station
- Pump Station
- Sampled Sanitary Sewer Manhole
- Sanitary Sewer Manhole
- Outfall
- Completed Video Inspection
- Sanitary Sewer
- Former Installation Boundary

0 600 1,200
Feet

N

Sanitary Sewer Sampling Results